



CONTROL PACKAGE

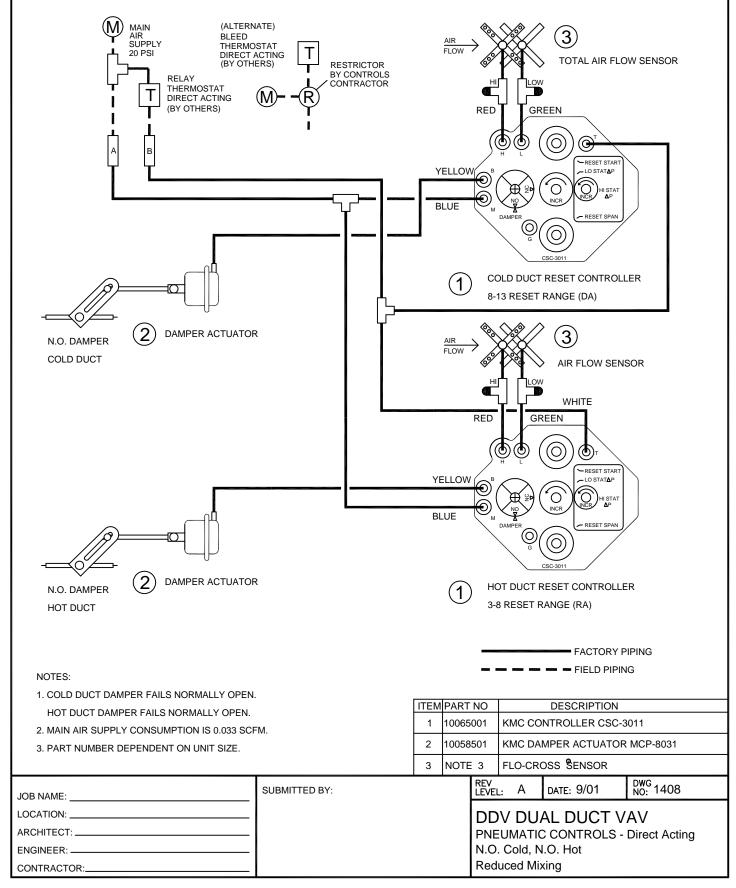

WWW.TUTTLEANDBAILEY.COM 1408 - 9/01

CONTROL DIAGRAM

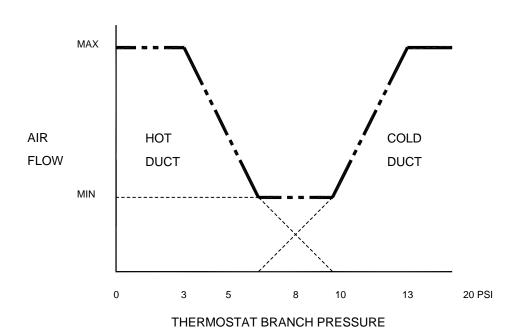

SEQUENCE OF OPERATION

- 1.) Hot duct air flow is at maximum and cold duct air flow is at zero when the thermostat branch pressure is at 3 PSIG or less. On a rise in room temperature the thermostat branch pressure will increase and hot duct air flow will decrease. When hot duct air flow decreases from minimum to zero, the cold air duct will open to maintain the minimum air flow. As branch pressure continues to increase to 13 PSIG or greater the cold duct air flow will increase to maximum. The reverse will occur with a drop in room temperature.
- 2.) The hot duct damper fails open and the cold damper fails open with loss of pneumatic air.

WWW.TUTTLEANDBAILEY.COM 1408P2 - 9/01