


CONTROL PACKAGE




WWW.TUTTLEANDBAILEY.COM 1455 - 9/01

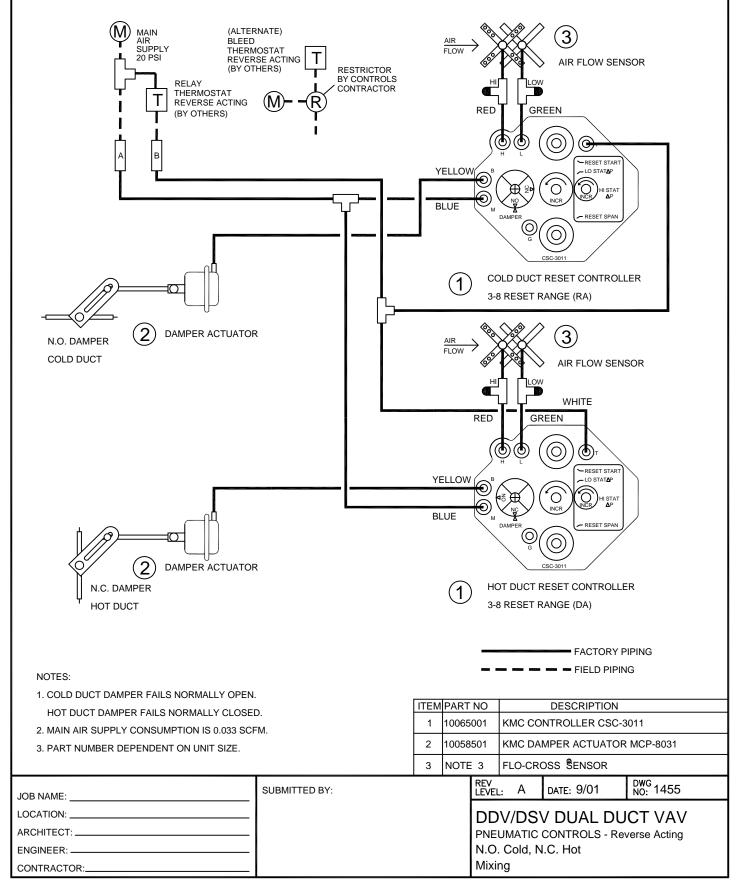

CONTROL PACKAGE 1455

CONTROL DIAGRAM

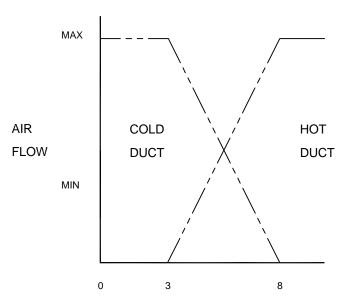

THERMOSTAT BRANCH PRESSURE

SEQUENCE OF OPERATION

1.)

Hot duct air flow is at maximum and cold duct air flow is at zero when the thermostat branch pressure is at 8 PSIG or greater. On a rise in room temperature the thermostat branch pressure will decrease and hot duct air flow will reduce to 0 and the cold duct air flow increases to maximum at 3 PSIG or less. The reverse will occur with a drop in room temperature.

2.)

The hot duct damper fails closed and the cold damper fails open with loss of pneumatic air.

WWW.TUTTLEANDBAILEY.COM 1455P2 - 9/01